

BRASS CHECK VALVE WITH STRAINER BASKET



ISO 9001:2000

Size : DN 1/2" to 4"
Ends : Female BSP
Min Temperature : + 0°C
Max Temperature : + 65°C
Max Pressure : 16 Bars (up to DN 1")
Specifications : All positions
Stainless steel strainer
Nylon throttle

Materials : Brass body

BRASS CHECK VALVE WITH STRAINER BASKET


SPECIFICATIONS :

- All positions (respect the flow direction indicated by the arrow)
- Threaded female BSP
- Nylon throttle
- Stainless steel strainer
- Mesh 2 mm

USE :

- For all common fluids
- Min Temperature Ts : + 0°C
- Max Temperature Ts :+ 65°C
- Max Pressure PN : 16 bars up to DN 1" , 10 bars from DN 1"1/4 to 2" and 8 bars over

HEAD LOSS GRAPH :

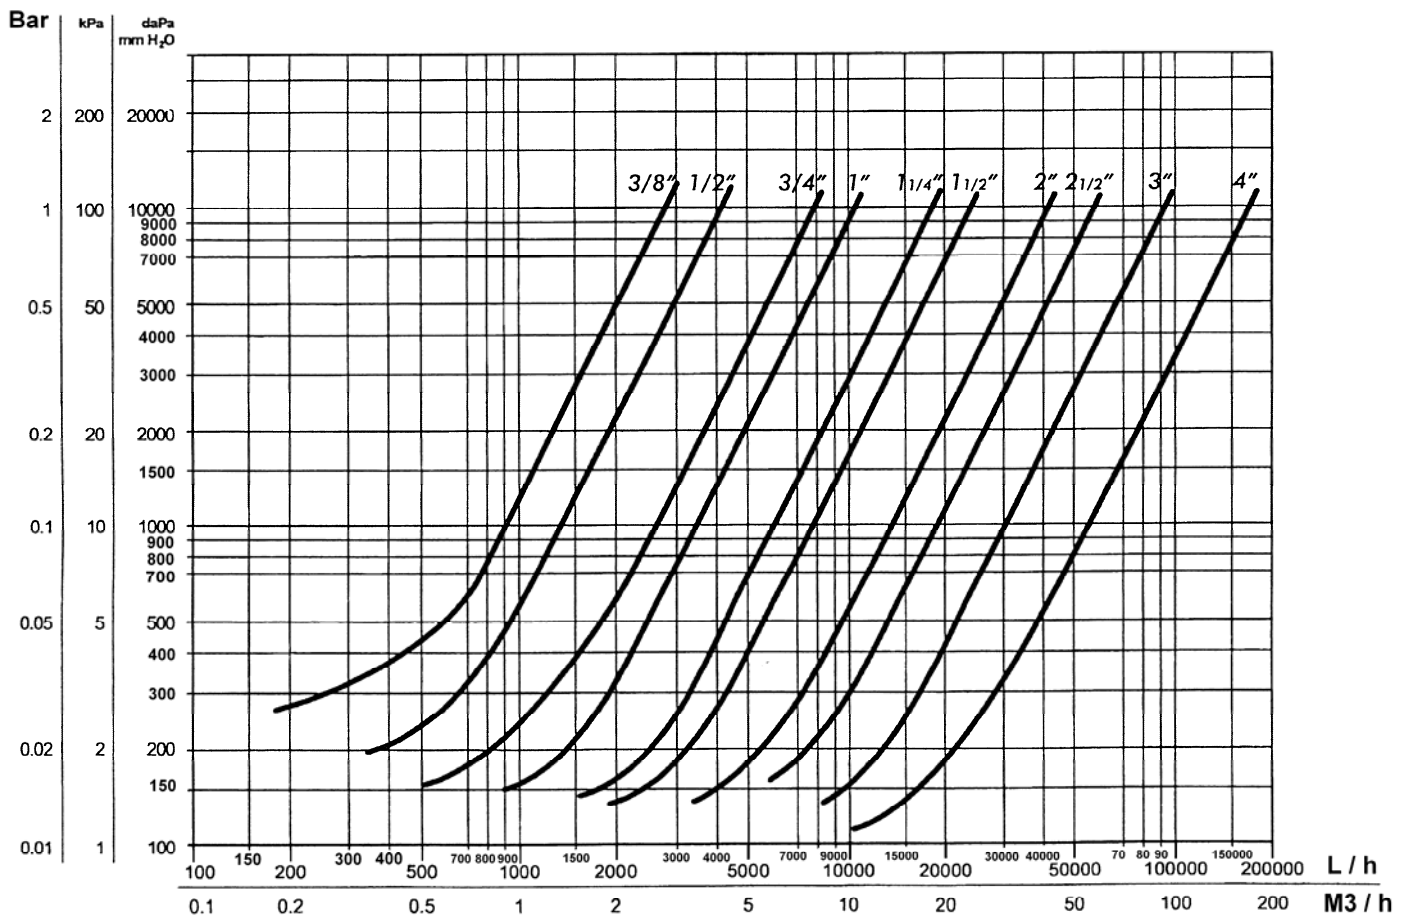

BRASS CHECK VALVE WITH STRAINER BASKET


OPENING PRESSURE :

- Opening pressure between 20 and 200 mbar

RANGE :

- Threaded BSP cylindric ends from DN 1/2" to DN 4"


MATERIALS :

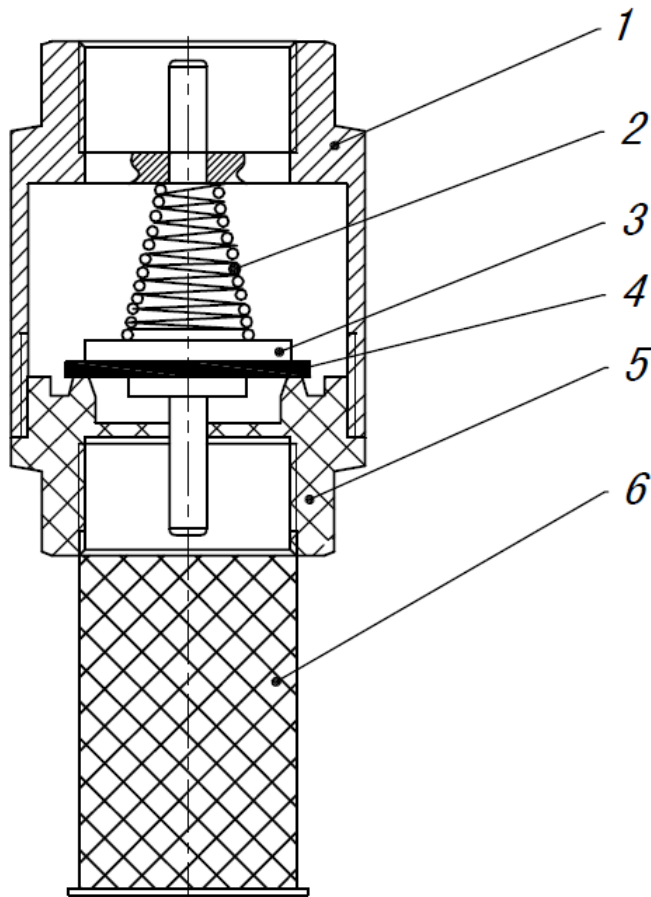

Item	Designation	Materials
1	Body	Brass
2	Spring	Stainless steel
3	Throttle	Nylon
4	Gasket	NBR
5	Bonnet	ABS
6	Strainer	Stainless steel

BRASS CHECK VALVE WITH STRAINER BASKET

SIZE (in mm) :

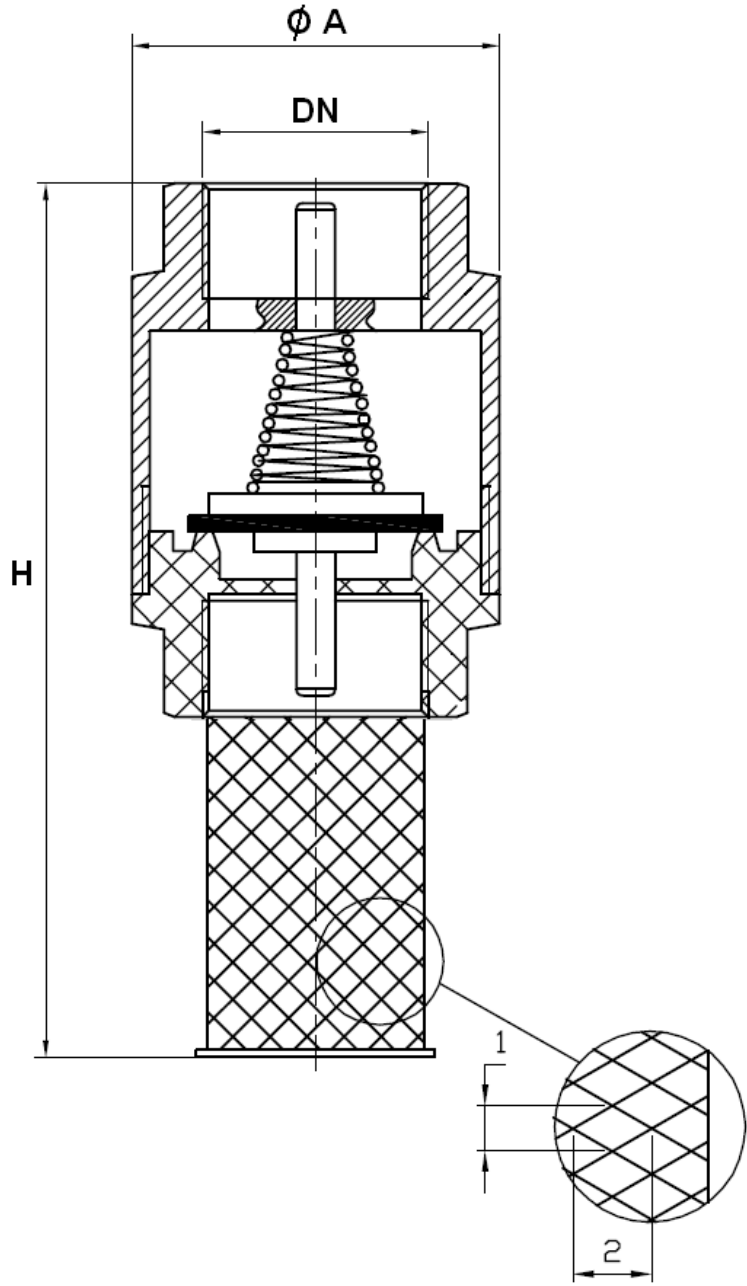

Ref.	DN	1/2"	3/4"	1"	1"1/4	1"1/2	2"	2"1/2	3"	4"
311	Ø A	32.5	42.5	47.5	57.5	68	80.5	102	111	140
	H	66	75	86	100	111	130	155	168	185
	Weight (Kg)	0.076	0.117	0.159	0.246	0.310	0.537	0.913	1.145	1.840

BRASS CHECK VALVE WITH STRAINER BASKET**STANDARDS :**

- Fabrication according to ISO 9001 :2000
- DIRECTIVE 97/23/CE : Concerned by article 3, § 3
- Threaded female BSP cylindric

ADVICE : Our opinion and our advice are not guaranteed and SFERACO shall not be liable for the consequences of damages. The customer must check the right choice of the products with the real service conditions.

BRASS CHECK VALVE WITH STRAINER BASKET

INSTALLATION INSTRUCTIONS

GENERAL GUIDELINES :

- Ensure that the check valves to be used are appropriate for the conditions of the installation (type of fluid, pressure and temperature).
- Be sure to have enough valves to be able to isolate the sections of piping as well as the appropriate equipment for maintenance and repair.
- Ensure that the valves to be installed are of correct strength to be able to support the capacity of their usage.

INSTALLATION INSTRUCTIONS :

- **Before installing the check valves, clean and remove any objects from the pipes** (in particular bits of sealing and metal) which could obstruct and block the valves.
- **Ensure that both connecting pipes either side of the check valve (upstream and downstream) are aligned (if they're not, the valves may not work correctly).**
- **Make sure that the two sections of the pipe (upstream and downstream) match, the check valve unit will not absorb any gaps. Any distortions in the pipes may affect the tightness of the connection, the working of the check valve and can even cause a rupture.** To be sure, place the kit in position to ensure the assembling will work.
- Before starting the fitting, ensure that the threads and tapping are clean.
- **If sections of piping do not have their final support in place, they should be temporarily fixed. This is to avoid unnecessary strain on the check valve.**
- The theoretical lengths given by ISO/R7 for the tapping are typically longer than required, the length of the thread should be limited, and **check that the end of the tube does not press right up to the head of the thread.**
- For the sealing assembly check valve piping, it is essential to use products that are compatible with the requirements of the French water agreement ACS : **plumbers hemp proscribed.**
- If mounting on an air conditioning with PER tubing and hoses, it is necessary to support the tubes and hoses with the fixing to avoid strain on the check valve.
- When screwing the check valve, ensure that you only rotate on screwed side by the 6 ended side. Use an open ended spanner or an adjustable spanner and not a monkey wrench.
- **Never use a vice to tighten the fixings of the check valve.**
- Do not over tighten the check valve. Do not block with any extensions as it may cause a rupture or weakening of the casing.
- **In general, for all check valves used in buildings and heating, do not tighten above a torque of 30 Nm.**
- If there is a direction changing or if there's another material, it's better to take away the check valve so that it is outside the turbulence area (**between 3 and 5 times the ND before and after**).
- After a pump please refer to norm NF CR 13932 to install the check valve.